

TABLE 3 - Marine Environment Specifications on Overseas Projects

Specification	Unit	Norway	Canada	Finland	Channel Tunnel, U.K.
Comp. Strength	MPa	x	x	x	
Max. w/b ratio		x	x	x	x
C ₃ A Content		x			
Binder Content	kg/m ³	x		x	x
Chloride diffusion co-efficient	m ² /s	x	x		
Cover to rebar	mm	x	x	x	

Inspection of this data shows conclusively that in Australia, a prescriptive approach to conformance is based on minimum strength, binder content, cover and minimum curing in at least 8 of the 11 (i.e. 73%) of specifications surveyed.

Performance testing based on chloride ion diffusion and rapid chloride ion penetration (RCIP) account for less than 10% in Australia and up to 50% in overseas specifications.

Clearly, there has been a general reluctance for specifiers to commit themselves and their clients to specification requirements that extend beyond the provisions of current codes of practice. This is not, we would suggest, due to ignorance, but rather due to the contractual certifications required for project delivery. The time required to realise reliable results, costs and uncertainty of specifying diffusion based testing together with the widespread legal view that the codes reflect current knowledge and, therefore, acceptable practice all mitigate against deviation from the codes. For these reasons specifiers tend to specify concrete for marine conditions on a prescriptive basis. This approach provides a practical way for suppliers and contractors to demonstrate compliance at the quality control level of project management.

PERFORMANCE CRITERIA IN SPECIFICATIONS

Irrespective of the method and quantum of test(s) specified under a contract (strength and cover, sorptivity, absorption and the like) for marine environments, the contractor must consider the implications of material pre-qualification on the one hand and quality control compliance during the performance of the work on the other.

When the specifier is considering the method of specification, it should be clear that peripheral issues surrounding any testing become very important and can lead to contractors pricing the work as-they-see-it. If not properly specified, the seeds for dispute between the parties will have been sown even before a winning bid is awarded.

Factors such as duration of any test, the relative ease, cost, degree of accuracy and consistency must be considered so that the specifier makes appropriate use of testing within the contractual framework. For instance, it may be unreasonable

to require a two-month material pre-qualification period during a one-month tender period. As well, tests must be reliable and repeatable. Any acceptance criteria nominated must be quoted in the context of the precision of the test method. The risks associated with compliance must be well balanced and any consequences of non-compliance must be clearly described in the specification.

ISSUES WITH CONTRACT SPECIFICATIONS

It is rare that specifications for use in construction contracts for marine structures are written in a concise, enforceable manner. Frequently, standard prescriptive specifications are adopted and amended to add some particular requirement for chloride ingress and/or electrical test limitation. It is even more rare for specifications to provide the time necessary for all the specified pre-requisites to be complied with. In BOOT, D&C or similar contracts, time (or the lack thereof) for development of trial mixes and related compliance criteria becomes of critical importance. The time available between award of the work and commencement of concrete manufacture often renders it impossible to comply with the specification.

To this end, the recommendation in the CIA Marine document⁽⁵⁾ (Z13) should remedy the situation when the principles of pre-qualification of materials and concrete mixtures become more widespread and specifiers realise the need to provide time if acceptable and meaningful outcomes are to be achieved. This matter needs to be urgently addressed otherwise considerably more dispute between contracting parties will emerge than is currently the situation. Listed below are four specification extracts that details the compliance criteria for contracts recently completed with which the authors have been involved. Clearly, each of those specifications has the potential to result in dispute because of lack of understanding by the specifier of either the test or standard relating to the test.

Specification 1

Exposure Classification	C
Concrete Strength at 28 days	50
Concrete cover	60
Shrinkage (56 days)	600
Maximum chloride penetration	1×10^{-12} (m ² / Second)

Specification 2

The concrete shall be 1000 coulombs	
Concrete Strength at 28 days	50
Concrete cover	50

Specification 3

Class of concrete	S50
Slump	80-100
Air content	2% +/- 1.5%
Cement type	GB (may contain slag/fly ash/silica fume)
Shrinkage (56 days)	550

Max W/C ratio	0.40
ASTM C1202 modified 28days	<1000 coulombs (1 test / month irrespective of volume)
ASTM C1202 modified 56 days	<500 coulombs
Curing	7 days

Specification 4

Specified exposure class, strength, cover, and shrinkage to prescriptive limits.

Contract award date to first placement of concrete under the contract = 6 weeks.

During this 6 week period, - trial mixes + 28-Day curing + 56-Day chloride ponding tests + 2 weeks approval period was specified. Total time required by contractor = 17 weeks.

Clearly impossible of performance.

Extensions of time were not allowable due to contract conditions.

Concrete deemed conforming only if 28-day coulomb values obtained during progress of the work of the contractor $\leq 90\%$ of the coulomb value determined at the 56-day trial mix stage. For part of the works add calcium nitrite and perform RCIP test on that concrete as well.

ISSUES WITH CHLORIDE DIFFUSION LIMITS IN SPECIFICATIONS



In an attempt to move away from the prescriptive approach for durability design, researchers and specifiers have focused on comparing the material resistance to the anticipated deterioration process encountered in marine conditions. In the case where special concrete mixes with very low water/binder (0.29-0.30) ratios, high cement content and super-plasticisers are employed, very little information exists on the likely long-term resistance of such concrete to the rate of chloride ingress over time. In this context the most important material resistance is the chloride diffusion coefficient. The determination of coefficients is a

complex and time-consuming procedure.

Figure 1 Apparatus for establishing chloride diffusion coefficient

Although chloride penetration into concrete follows a non-steady state process, current practice is to immerse the concrete specimens in saline solutions at constant salt concentrations for various time intervals ranging from 28, 35, 56, and 90 days depending on the specification. After immersion the chloride profile is determined by taking samples from the exposed face at various depths to determine the chloride diffusion coefficient Figure 1 using Fick's second law by curve fitting. The NORDTEST Method NT Build 443-1995⁽⁶⁾ is one such test for this property.

The NORDTEST test procedure uses a profile grinder to grind out dust from a specimen for analysis at depth increments 0.5mm to 1mm. For every depth increment approximately 5 grams are collected for analysis Figure 2.



Figure 2
Profile grinding

There seems to be general agreement that where proper correlation of results of saline ponding tests can be established with short-term electrical tests, then both diffusion limits and resistance limits are acceptable inclusions into project specifications. However, the issue is not as simple as it seems. Recent research⁽⁷⁾ has shown that, theoretically, the use of Fick's law in the prediction of chloride penetration is not appropriate. It is valid only for non-ionic diffusants through a homogeneous inert medium. Chloride penetration into concrete is clearly an ionic transportation process involving other ions in the pore solution.

As well, the binder composition determines the time required for chemical reaction in the formation of hydration products. The rate of chloride diffusion is therefore also dependent on the completeness of the hydration process. Appendix A⁽⁸⁾ shows the field results of diffusion coefficients (D_e) after 28 and 56 days immersion in a saline solution and chloride profiles determined in accordance with the NORDTEST procedure for the recent M5-East project in Sydney.

Tests were performed on samples cured under standard 28-day moist curing conditions in the laboratory and also on 1-day steam cured plus 27-day air curing conditions.

The diffusion coefficient nominated in the specification at age 56-days was achieved. The rapid chloride penetrability test (ASTM C1202) requirement at age 28-days was, however, not achieved. This is because reliable correlation had not been established and it was not until age 84-days that technical compliance for chloride penetrability was achieved. Quality control compliance, albeit outside the limitations imposed by the specification became a matter of dispute. Because of the issues raised, it is not surprising the CIA document states in its conclusion *"there is significant debate as to the appropriateness of a diffusion coefficient obtained from a 28-56 day test to provide a reasonably accurate estimate of design life"*.

One important conclusion from this testing is that when concrete is properly steam cured in accordance with RTA specification Part B80 to achieve a 24 hour maturity of 350 deg centigrade hours, 28-day and 56-day diffusion coefficients are obtained that are comparable to those from standard laboratory tests after standard 28-day water curing. This clearly demonstrates the superior durability properties of steam-cured precast concrete. This is because in-situ concrete structures can not be cured nearly as effectively as standard 28-day water curing under laboratory conditions.


ISSUES WITH THE RCIP (COULOMB) TEST IN SPECIFICATIONS

Permeability, diffusion and absorption are the important physical processes controlling chloride penetration into concrete during ponding tests. However, electrical resistivity appears to be the primary factor controlling charge passed during the RCIP test. The sensitivity of these two tests can cause significant variations in the ranking of the apparent permeability of various concretes.

Therefore, it is of concern to contractors that where the ASTM C1202-97 RCIP (Rapid Chloride Ion Penetration) or "Coulomb" test is specified for quality control testing, that the results of tests will generally **not** have been correlated to long-term salt-water ponding tests because of the lack of time under the contract. The RCIP test method is applicable for material pre-qualification only to types of concrete where correlations have been established between this test procedure and long-term chloride ponding procedures.

It has been established that proper and reliable correlations do not exist between the six-hour RCIP test results and 28, 56 and 90-day ponding test results. Accordingly, it has been recommended by the Precast / Prestressed Concrete Institute⁽⁹⁾⁽¹⁰⁾ of North America that long-term ponding tests for the purpose of correlation should be of minimum duration of 1 to 2 years based on 2.5 year tests conducted by the Virginia Department of Transportation (VDOT), USA.

The data points in Figure 3⁽¹⁰⁾⁽¹¹⁾ are the combined results of a diffusion study for concrete, the subject of testing in Ref (10) and (11). Concrete mixes were prepared with and without calcium nitrite, and W/C ranging from 0.31 to 0.48 and silica fume contents of 7.5% to 15%. The data from the 24 concretes in Figure 3 show that there is a significant change in the relationship at a coulomb level of around 2500 and not at the 1000 coulomb level as is implied in Table 1 of ASTM C1202 specification. This shows the effectiveness of a low w/c in decreasing the chloride permeability of concrete.

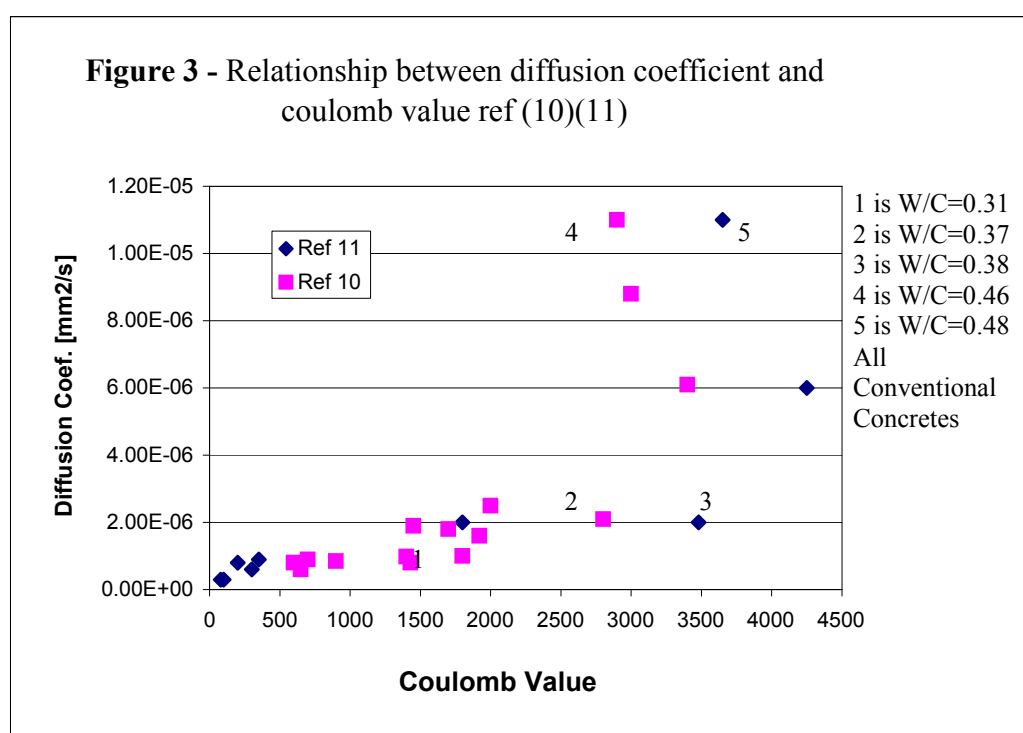

Very low diffusion coefficients of 2.0 to 1.0×10^{-6} mm²/second were achieved even though coulomb values up to 2500 were reported. This data shows that very low permeability concretes may be the subject of non-conformance and rejection where a limit of 1000 coulomb has been specified, yet values up to say, 2500 coulombs will provide equivalent high quality, low permeability concrete.

Further, the RCIP test is not ion specific⁽¹²⁾ and, as a result, several concurrent processes are likely to be involved within the influence of an electric field. Because the test is not ion specific, it follows that the test is not a good indicator of concrete quality when various binder types are used, and in particular, where supplementary cementitious materials are used. Results can also produce misleading results when corrosion inhibitors such as calcium nitrite have been admixed into concrete. The results using this test can indicate higher coulomb values, that is, lower resistance to chloride ion penetration than from tests on identical concrete mixes without calcium nitrite. Conversely, the addition of silica fume will lower the coulomb values. Clearly, the contractor is exposed to considerable risk if the RCIP test is specified for conformance testing at the quality control level of a project.

As well, there is concern regarding the precision and repeatability of results. These procedures are subject to testing error and variation to the property being tested in a similar manner to compression testing. The specification should therefore state a characteristic value and allow statistical acceptance similar to that provided in AS 1379⁽¹³⁾ for the sampling and testing of concrete for compliance. This would require knowledge of the standard deviation usually achieved in laboratory and field-testing for the particular test. For example, acceptance criteria for the compressive strength of concrete is based upon a 95% confidence limit (ie 5% defective) in the normal binomial distribution of results where the dispersion or variance⁽¹⁴⁾ about the mean value is:

$$S^2 = \sum(x_i - x_{av})^2 / (n-1) \quad \text{for summation limits } i = 1 \text{ to } n \quad \text{and therefore;}$$

the mean strength required is $x_{av} = F'c + 1.65(S)$

However, most specifications which nominate the RCIP test to determine the rate of ion migration state single, lower bound limits and do not recognise that statistical variance about a mean value will occur.

Figure 4 shows the recent actual chloride permeability of a Classification C (marine concrete) mix with a w/c=0.30 containing cement plus flyash. The 28-day charge passed of 4000 coulombs would indicate that this concrete has high chloride permeability, yet at age 84-days the charge passed is 1050 coulombs. This example indicates the time effect in

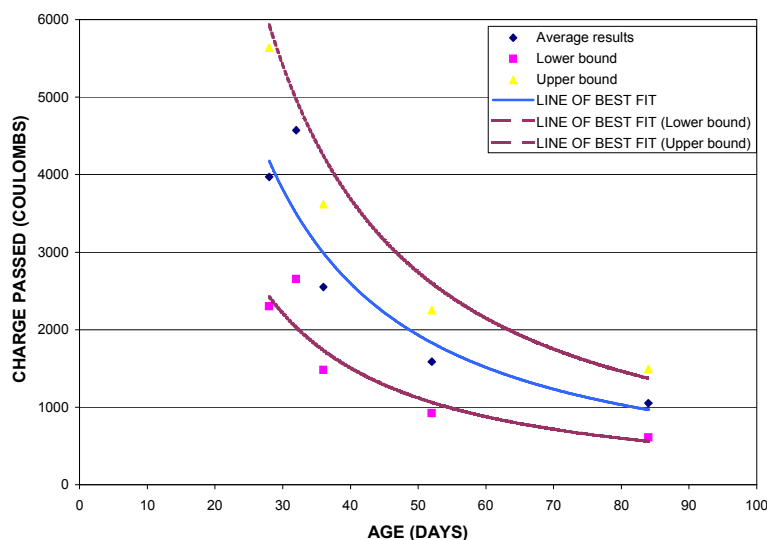


Figure 4 **SCI MIX 184**
Rapid Chloride Permeability to ASTM C1202-97
Trendline calculated by method of least squares fit

assessment for both D_e and the C1202 test. On the basis of 28-day testing the concrete would be deemed non-conforming under the contract. ASTM C1202 states that for single-operator laboratory precision, the coefficient of variation of a single test result has been found to be 12.3%. The coefficient of variation between laboratories has been found to be 18%. This means that the results of two properly conducted tests by the same operator or different laboratories on concrete samples from the same batch and of the same diameter can differ by more than 42% and 51% respectively. This is a significant statement that should alert specifiers for the need to introduce tolerance limits into the acceptance criteria.

Figure 4 also shows the upper and lower bound coulomb values for the noted precision.

For any one of the above concerns a contract dispute is liable to result between the parties where a single figure coulomb value has been specified. Accordingly, the test is not appropriate for use as a quality control test in contracts and must not be specified that way.

CONCLUSIONS

The Concrete Institute Recommended Practice “*Performance Criteria for Concrete in Marine Environments*” has set out to review and put forward recommendations for acceptable performance criteria with respect to the whole of the design and construction process for concrete in marine environments. It has considered the appropriateness of test methods as applicable at the Design, Pre-qualification and Quality Control stages in a contract. The main conclusions that can be drawn from the document and the foregoing discussion are:

- (i) It is clear that the widely used performance criteria based on ion diffusion models are currently still in the experimental stage and are therefore not satisfactory for the basis of acceptance testing of production concrete
- (ii) That any form of short-term testing other than compressive strength may or may not be a reliable indicator of long-term performance
- (iii) That caution needs to be exercised in using performance criteria for marine environment exposures, especially where correlations with long-term test results are necessary but are not available
- (iv) That low (0.30-0.34) w/c concrete will be most effective in decreasing the chloride permeability of concrete.
- (v) That the coulomb values in Table 1 in the ASTM C 1202 document (reproduced as Table 7 in the CIA document) are misleading and should not be used for compliance criteria in specifications as the test was developed only for use as a rapid comparison between concrete mixes
- (vi) That concretes with coulomb values of around 2500 can have similar low permeability properties to concrete with 1000 coulombs
- (vii) That contractual disputes are likely where insufficient time is provided to allow a proper assessment of performance based testing in the pre-qualification of materials
- (viii) That contractual disputes are likely where inappropriate tests are specified for routine quality control acceptance criteria
- (ix) That the risk to the contractor is high where badly constituted specifications form part of the contract documents

Currently, controversy surrounds the specifying and use of emerging short-term durability based test methods to predict the long-term durability performance of concrete. It is a considered view that insufficient confidence can be placed on results obtained from such test methods.

From a contractual viewpoint, only **acceptable** criteria can be specified. The Recommended Practice document (Z13) recognises compressive strength as the **only** acceptable criterion for pre-qualification and quality control. Accordingly, in the immediate future, compressive strength should be the only quality control test that should be specified and used under a contract.

APPENDIX – A

Table 5
28-day average chloride diffusion coefficient (least squares best fit) for chloride profile shown in Figure 6a below

NORDTEST METHOD: NT BUILD 443 - 1995			
Client: Structural Concrete Industries			
File No:	410/99		
Lab Sample No.		18845	
Sample Number		SCI 57273-K	-1
Date of Casting		19-Oct-99	
Date of Grinding		14-Dec-99	
Background Chloride Content	C_o	0.001	%
Chloride Content at Surface	C_s	0.660	%
Exposure time in Salt Solution	t	28	days
	t	2419200	sec
Depth, mm	% Cl by wt	Macros Eq	Trial Di
0.25	0.625	#VALUE!	5.66E-12
0.75	0.562	#VALUE!	4.50E-12
1.5	0.499	#VALUE!	5.08E-12
2.5	0.439	#VALUE!	5.98E-12
3	0.355	#VALUE!	6.00E-12
5	0.246	#VALUE!	5.83E-12
7	0.127	#VALUE!	7.92E-12
9	0.022	#VALUE!	3.91E-12
		Average D =	5.61E-12 m ² /sec
		Best Fit Diffusion Coefficient	D = 5.61E-12 m²/sec
		Best Fit Chloride Content at Surface	C_s = Trial Di %
Note: 28 days standard water cured then submersed in salt solution for 28 days			

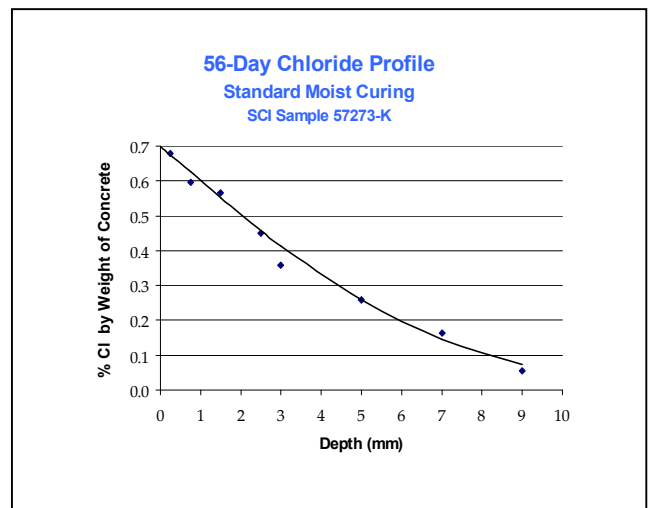
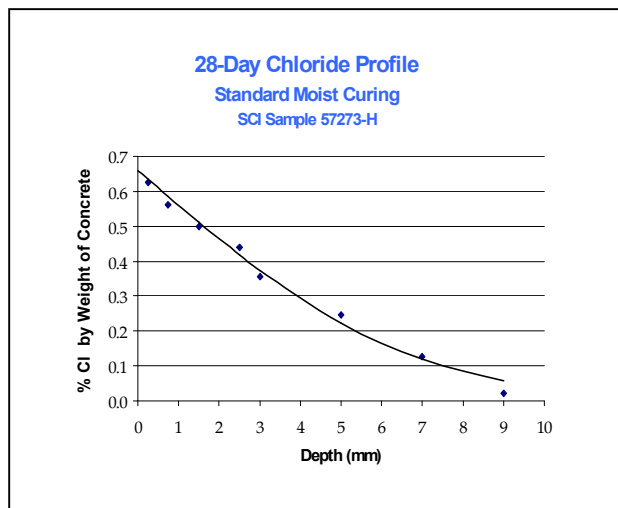


Figure 6a and 6b – Chloride profile after 28-days and 56-days in salt solution after 28-day Standard water curing

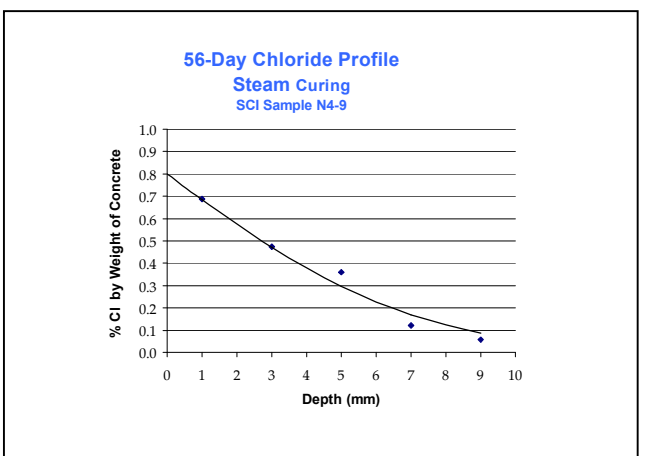
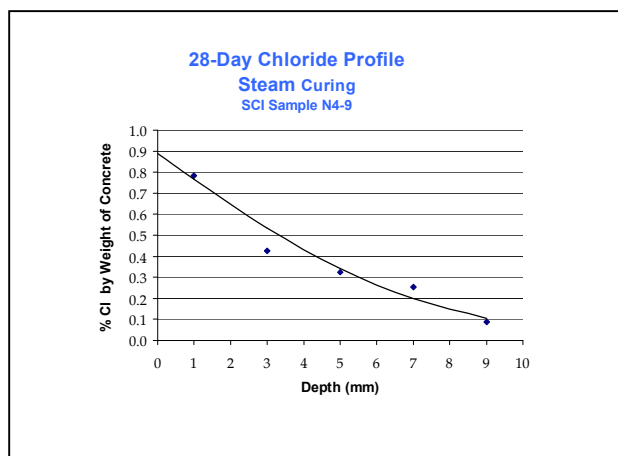


Figure 7a and 7b – Chloride profile after 28-days and 56-days in salt solution after 1-day Steam curing + 27-day Air

REFERENCES

1. SAA Code for Concrete in Buildings, CA2-1963, Standards Association of Australia.
2. SAA Concrete Structures Code, AS 1480-1974, Standards Association of Australia.
3. Concrete Structures, AS 3600-1988, Standards Association of Australia.
4. Electrical Indication of Concrete's Ability to Resist Chloride Ion Penetration, ASTM C 1202-97.
5. CIA NSW Branch Committee, "Performance Criteria for Concrete in Marine Environments", Concrete Institute of Australia, Z13, October 2001.
6. Accelerated Chloride Penetration, NORDTEST Method NT Build 443-1955.
7. Sirivivatnanon V and Cao H T, "An Engineered Model for Service Life of Marine Concrete Structures", Proceedings of the Durability of Building Materials and Components 8 – Service Life and Asset Management, Vol 1, May 1999, pp 94-104.
8. Merretz W E, Smith G F A, Borgert J, "Determination of Comparative Chloride Ion Diffusion Coefficients for High Strength, Standard cured and Steam cured concrete and attempts to Correlate with Rapid Chloride Penetrability Testing to ASTM C 1202", Classified internal report, July 1999 – March 2000.
9. Pfeifer W. Donald, "High Performance Concrete and Reinforcing Steel With a 100-Year Service Life", PCI Journal, May-June 2000, pp 46-54.
10. Pfeifer W. Donald, McDonald B. David, Sherman R. Matthew, "Durability Aspects of Precast Prestressed Concrete, Part 2: Chloride Permeability Study", PCI Journal, July-August 1996, pp 75-95.
11. Berke N S, Pfeifer D. W, Weil T. G, "Protection Against Chloride-Induced Corrosion", Concrete International, Vol 10, No 12, December 1988, pp 45-55.
12. Cao Trinh, Buccia Liana, Meck Elena, "Rapid Assessment of concrete's resistance to chloride penetration – modified ASTM C 1202". Concrete Institute of Australia, Concrete '97 Proceedings, May 14-16, pp 391-397.
13. The specification and manufacture of concrete, Australian Standard AS 1379, Standards Australia
14. Anderson, Sweeny, Williams, "Statistics for Business and Economics", International Edition, West Publishing Company, San Francisco